
Installation Instructions

1. Before fitting the collar ensure that any gaps between the pipe and the separating element are sealed with 20mm deep stonewool to plug the opening.
2. Place a suitable collar around the pipe and ensure that the collar shell and fixing lugs are positioned tightly to the surface of the floor, so that the fixings can be inserted fully.
3. Where the surface is uneven, apply a sealing bead of Protecta® FR Acrylic between the floor and the collar shell.
4. Attach the collar with ≥ Ø4 x 40mm long masonry screws or expansion bolts.

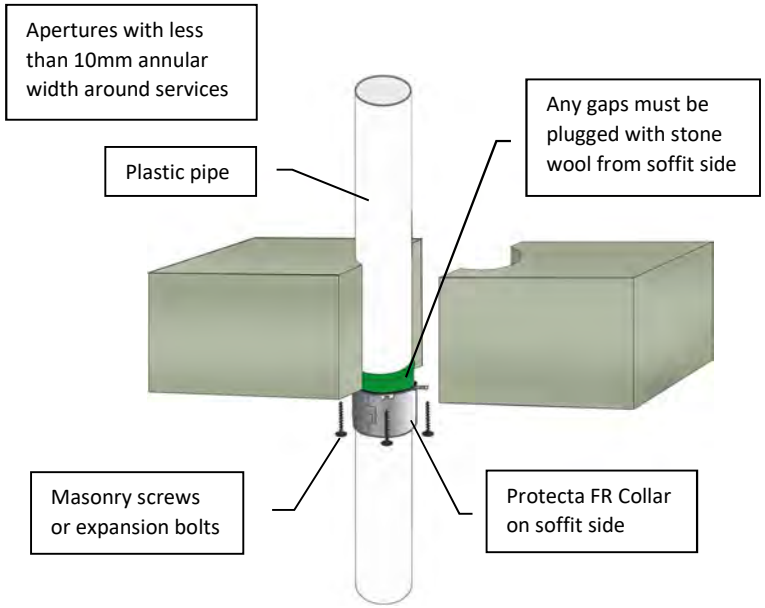

Services	Min. Collar Height	Classification
≤ Ø50mm PVC-U & PVC-C	30mm	EI 60 C/C, EI 60 U/C, EI 60 C/U, EI 60 U/U (E 90)
≤ Ø90mm PVC-U & PVC-C	50mm	EI 120 C/C, EI 120 U/C, EI 60 C/U, EI 60 U/U
≤ Ø110mm PVC-U & PVC-C	30mm	EI 60 C/C, EI 60 U/C, EI 60 C/U, EI 60 U/U
≤ Ø110mm PVC-U & PVC-C	50mm	EI 120 C/C, EI 90 U/C (E 120), EI 60 C/U
≤ Ø160mm PVC-U & PVC-C	60mm	EI 120 C/C, EI 120 U/C, EI 60 C/U, EI 60 U/U
≤ Ø200mm PVC-U & PVC-C	60mm	EI 60 C/C (E 120)
≤ Ø315mm PVC-U & PVC-C	75mm	EI 60 C/C
Ø400x15.3mm PVC-U & PVC-C	100mm	EI 60 C/C
≤ Ø55mm PE, ABS & SAN+PVC	30mm	EI 60 C/C, EI 60 U/C, EI 60 C/U, EI 60 U/U
≤ Ø50mm PE, ABS & SAN+PVC	50mm	EI 240 C/C, EI 240 U/C, EI 60 C/U, EI 60 U/U
≤ Ø110mm PE, ABS & SAN+PVC	30mm	EI 60 C/C, EI 60 U/C
≤ Ø110mm PE, ABS & SAN+PVC	50mm	EI 120 C/C, EI 120 U/C, EI 60 C/U, EI 60 U/U
≤ Ø160mm PE, ABS & SAN+PVC	60mm	EI 120 C/C, EI 120 U/C, EI 60 C/U, EI 60 U/U
≤ Ø200mm PE, ABS & SAN+PVC	60mm	EI 120 C/C (E 240)
≤ Ø250mm PE, ABS & SAN+PVC	75mm	EI 240 C/C
Ø315x18.7mm PE, ABS & SAN+PVC	75mm	EI 240 C/C
Ø400x36.3mm PE, ABS & SAN+PVC	100mm	EI 90 C/C

Services	Min. Collar Height	Classification
≤ Ø50mm PP	30mm	EI 120 C/C, EI 120 U/C, EI 120 C/U, EI 120 U/U
≤ Ø110mm PP	50mm	EI 120 C/C, EI 120 U/C, EI 60 C/U, EI 60 U/U
≤ Ø140mm PP	60mm	EI 120 C/C, EI 120 U/C, EI 60 C/U, EI 60 U/U
≤ Ø160mm PP	60mm	EI 180 C/C, EI 180 U/C, EI 60 C/U, EI 60 U/U
≤ Ø200mm PP	60mm	EI 120 C/C
≤ Ø250mm PP	75mm	EI 60 C/C
Ø315x28.6mm PP	75mm	EI 60 C/C
≤ Ø400mm PP	100mm	EI 30 C/C

ETA 21/0070

Client:

Job Title:

Products	Protecta FR Collar Stonewool
Application	Fire stopping of plastic pipes in rigid floors
Construction	Minimum floor thickness of 150 mm and comprise aerated concrete or concrete with a minimum density of 650kg/m^3

Fire & Sound classification

Fire classifications in tables on the left. For full specifications, please refer to the Installation Instructions.

Sound reduction (seal only)

58dB

Polyseam Ltd, 15 St Andrews Road, Huddersfield, West Yorkshire, HD1 6SB
Tel: +44 (0) 148 4421036
Email: post.uk@polyseam.com

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, is intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

For all technical details on the products specified please refer to the technical data sheets that can be found on www.protecta.eu

Signed and approved:

Sheet size:	Drawn date & no:
A4	27/7/19
Scale:	Drawn by:
NTS	K.B